

## Variants

**CEFLPIR 10VDC:** PIR occupancy switch (presence detection) with 1-10V daylight linked dimming.

## Troubleshooting

### The load will not switch on:

- The moving body is not emitting more IR than the background.  
(Person wearing insulating clothing in a warm environment)
- Person is too far from the PIR switch, see detection diagram.
- Person is moving unusually slowly (perhaps when testing).

### Lamps do not dim:

- Disconnect the CEFLA PIR 10VDC, the voltage across the terminals of the 1-10V ballast should be at 10V and the lamp should be on full, if not there may be a problem with the 1-10V ballast.
- Reconnect the 1-10V lines and check whether the voltage can be varied via the CEFLA PIR 10VDC.

## Precautions and Warranty

This product conforms to BS EN 60669-2-1 and BS EN 55015.

Please ensure the most recent edition of the appropriate local wiring regulations are observed and suitable protection is provided e.g. a 10 amp circuit breaker and voltage surge protection. Please ensure that this device is disconnected from the supply if an insulation test is made.

This product is covered by a warranty which extends to 5 years from the date of manufacture.

## Products available from DANLERS

- PIR occupancy switches • Daylight linked dimmers • Manual high frequency dimmers
- Photocells • Radio remote controls • Time lag switches • Outdoor security switches
- Dimmers • Heating, ventilation and air-conditioning controls • Bespoke / O.E.M. products

**Please call for more information or a free catalogue, or visit our website.**

DANLERS Limited, Vincients Road, CHIPPENHAM, Wiltshire, SN14 6NQ, UK.  
Telephone: +44 (0)1249 443377 Fax: +44 (0)1249 443388  
E-mail: sales@danlers.co.uk Web: [www.danlers.co.uk](http://www.danlers.co.uk)  
Company Registered Number 2570169 VAT Registration Number 543 5491 38



# DANLERS

## Installation notes

## PIR occupancy switch with 1-10V dimming

### CEFLA PIR 10VDC

DANLERS passive infra-red occupancy (absence detection) switches with closed loop control (CEFLA PIR 10VDC) can be used to control high frequency 1-10VDC dimmable ballasts. The product can be flush mounted into suspended and plasterboard ceilings (diagram A). It includes two 2 metre connecting flexes, one 4-core cable for the supply and one 2-core cable for the 1-10V control.

These PIR switches incorporate a passive infra-red quad sensor to detect movement of a warm body within their detection zone (diagram B) and a photocell to monitor the ambient light level.

## Functions

When entering a zone of detection a momentary wall switch must be pressed to send a signal to the PIR to switch the lights ON at maximum and start the closed loop control to maintain the preset lux level value (LUX) between 30 and 1000 lux (default value 1000 lux). See diagram D.

**NO BACKGROUND ILLUMINANCE RUN ON TIME SET:** If no further movement is detected the lights will switch OFF after the set PIR hold timer (TIME) has expired. This time lag can be set via the TIME adjuster to 10 seconds, 20s, 40s, 80s, 2m30s, 5m, 10m, 20m or 40 minutes (default value 10 seconds). See diagram C. Alternatively, the momentary switch can be pressed for more than 2 seconds to switch the lights OFF.

**BACKGROUND ILLUMINANCE RUN ON TIME SET:** If no further movement is detected the lights will FADE to minimum after the set PIR hold timer (TIME) has expired OR if the momentary wall switch is pressed for more than 2 seconds. The lights will then stay at minimum until the background hold timer (RUN ON) has expired. The RUN ON time can be set via the RUN ON adjuster to 0, 1, 2, 5, 10, 15, 20, 30 minutes or infinite (default value is 0). See diagram D.

If the momentary wall switch is pressed for less than 2 seconds while the background hold timer is counting down, the lights will switch ON at maximum and start the closed loop control to maintain the set lux level value.

## Loading

They can dim up to 20 x 1-10V dimmable ballasts, assuming each ballast has a constant current output of 1mA.

These PIR switches can also switch up to:

6 amps (1500W) of dimmable fluorescent lamps. 2 amps (500W) of CFL, LED Drivers and LED lamps and fittings. Minimum load 2W.

## Installation procedure

- Please read these notes carefully before commencing work.  
In case of doubt please consult a qualified electrician.
- POSITIONING:** The CEFLA PIR 10VDC should be installed to achieve correct coverage of the area, see diagram A. Avoid locating this product where it is exposed to drafty conditions (exposed lobbies, open ceiling voids or near fans) or near heat sources.
- To cover larger areas PIRs should be spaced in a 5 metre grid formation, with one CEFLA PIR 10VDC and the rest as standard switching PIRs (CEFLPIR) with all Switch Line outputs connected together.
- Make sure the power is isolated from the circuit.  
The PIR should be connected as shown in diagram E:

Thick wire		Thin wire (1-10V control lines)
Brown	L Live in	Red + (polarity dependant)
Blue	N Neutral in	Blue - (polarity dependant)
Black	SL Switched Line out	
White	SW <sub>1</sub> Switch / Input	

## Start-up mode

When the PIR is powered up, it will switch on the load for 1 minute, the load will then switch off and the PIR will enter its Operating Mode.

## Time / Run-on / Lux set up

The LUX adjuster spindle on the side of the PIR is used to regulate the automatic daylight linked dimming function lux level (see diagram D opposite). This should be adjusted in situ by rotating the LUX adjuster slowly anticlockwise (+ to -) so that the desired level of brightness is achieved under the luminaire(s) being controlled.


Once the correct level is achieved and there has been no further adjustment to the LUX spindle, CEFLA PIR 10VDC will go through a 30 second delay before the automatic closed loop control will start.

CEFLA PIR 10VDC incorporates a fixed 90 second fade rate from maximum to the set back level.


## Sensitivity

CEFLA PIR 10VDC incorporates a sensitivity adjuster, labelled 'SENS', to reduce the range of detection from 100% to 50% in 9 steps (see diagram C opposite).


## A: Detection diagram

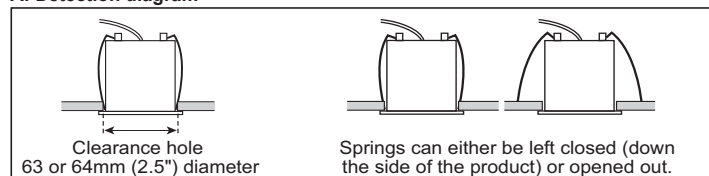


## B: Detection diagram

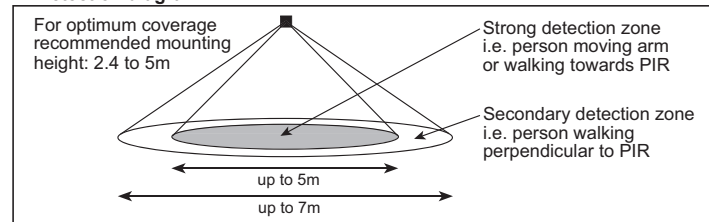

## C: Adjusting SENSITIVITY and TIME

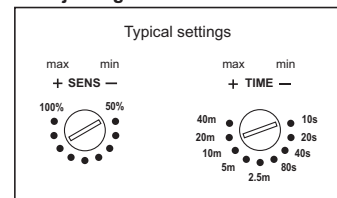

## D: Adjusting LUX and RUN-ON

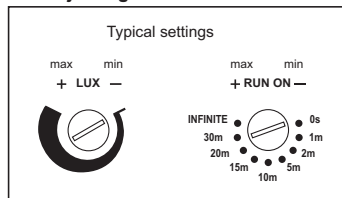

## E: Wiring diagram, CEFLA PIR 10VDC controlling several 1-10V dimmable ballasts

